

Naval Fuels & Lubricants

Cross Functional Team

Research Report

Navy Coalescence Test on Petroleum F-76 Fuel

NF&LCFT REPORT 441/12-013

20 June 2012

Prepared By:

CHRISTOPHER J. LAING Filtration Test Engineer AIR-4.4.5.1

Report prepared and released by:



Naval Air Systems Command Naval Air Warfare Center, Aircraft Division, AIR-4.4.1 Naval Fuels & Lubricants CFT 22229 Elmer Road Patuxent River MD 20670-1534

Reviewed and Approved by:

JOHN BUFFIN
Refueling Systems Mechanical Engineer
AIR-4.4.5.1

RICHARD A. KAMIN Fuels Team Lead AIR-4.4.5

Released by

DOUGLAS F. MEARNS Fuels & Lubricants Systems Engineer AIR-4.4.1

TABLE OF CONTENTS

	Page
LIST OF FIGURES	iv
EXECUTIVE SUMMARY	V
LIST OF ACRONYMS/ABBREVIATIONS	vi
1.0 BACKGROUND	1
2.0 OBJECTIVE	1
3.0 APPROACH	1
4.0 DISCUSSION	2
5.0 CONCLUSIONS	4
6.0 RECOMMENDATIONS	5
7.0 REFERENCES	5

EXECUTIVE SUMMARY

The Navy Coalescence Test (NCT) is a fit-for-purpose test which uses a specially manufactured small filter/coalescer cell to simulate the performance of a full scale filter/coalesce system while utilizing a small volume of fuel. This testing is designed to predict the performance of the filter/coalescer systems currently in use in the fleet.

Recently there have been numerous requests to test additives for diesel fuel and this test was conducted to create a petroleum non-additized diesel baseline. This test fuel met all the test requirements and passed the NCT. It is recommende for use in further NCT testing.

LIST OF FIGURES

Figure	Title	Page
Figure 1 NCT Theory of Opera	ion	2
Figure 2 Raw water level data b	y test hour	3
Figure 3 Calculated Water Coal	escence Data	4
LIST OF A	ACRONYMS/ABBREVIATIONS	
NCT	Navy Coalescence	Test
PPM	parts per mi	llion
HRJ		fuel
	DEFINITIONS	
	time it takes to flow the entire volume of fluid in a contain as resonance time	ainer,
Dissolved Waterwater that	s in solution with the fuel i.e. at or below the saturation	point
Free Waterwater in a	multi-fluid stream which is above the fluids saturation pe	oint
•	on device which acts upon a fluid stream, these may includescers or separators	ude
Coalescence the ability	to shed water from fuel	

NF&LCFT REPORT 441/12-013 20 June 2012 Page vi

This Page Intentionally Left Blank

Navy Coalescence Test on Petroluem F-76 Fuel

1.0 BACKGROUND

The Navy Coalescence Test (NCT) is a screening tool to determine the impact of fuel chemistry, fuel, and/or additives on filter-separator performance. The NCT is a scaled down version of a full-scale filter coalescer. The NCT utilizes a miniature version of a full size coalescer and separator assembled in a capsule. The capsule is engineered to have the same flow per unit area as a full size coalescer. The single pass flow rate is 33 mls/min when using diesel fuel, as per the manufacturer's recommendation. The test is comprised of flowing fuel, injecting a known amount of water upstream of the coalescer, and measuring the water concentration in the fuel downstream of the test capsule. The total water content in the fuel is measured at the 1) outlet of the tank (prior to water injection), 2) coalescer inlet (after water injection), and 3) coalescer outlet. By measuring and graphing the results of the water levels at those three points, the effects on coalescence can be determined. When coalescence is not affected, the tank and outlet water levels are close in value and give consistent results. When coalescence is compromised, the inlet and outlet levels of the coalescer are closer and give erratic results. The standard test duration is 80 hours. A flow schematic for the NCT is shown in Figure 1.

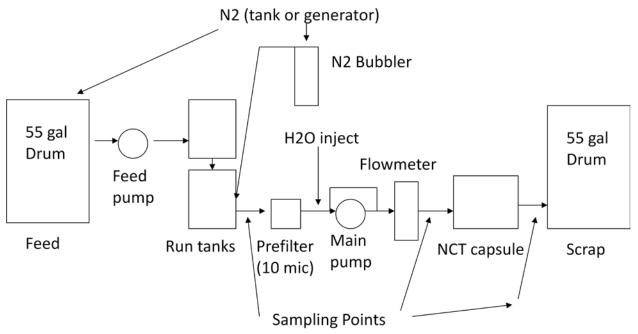


Figure 1: NCT Flow Schematic

Various applications of diesel fuel use call for specific additives to be added to the base fuel. This test was run to create an additive free baseline using petroleum based diesel fuel (F76) which could then be used as a comparison for future additive testing.

2.0 OBJECTIVE

The objective of this test is to determine the water shedding or coalescence properties of the test fuel. Free water levels upstream and downstream of the filter/coalesce test cell will be compared to a saturated level of water in the same fuel. Water is injected upstream of the filter/coalescer. A passing fuel will have downstream measurements which track with the saturated levels instead of the upstream levels. This will indicate satisfactory water separation properties of the test fuel.

3.0 APPROACH

Testing was conducted in accordance with the NCT Standard Work Package (SWP44FL-003). The base fuel was stored in epoxy lined drums, and put through a recirculating filtration stand before it entered the test rig. This is designed to remove any excess contaminants and establish a contaminant free baseline for the fuel. Each drum was recirculated with a drum pump for 22 turnovers to solubalize any large contaminants in the fuel stream and then recirculated for 122 turnovers through a series of filter/coalescers to remove any contaminants.

Once the fuel was contaminant free, it was placed in the test rig. Fuel drums were pressurized with nitrogen to both offset the vacuum produced by the feed pump and inert the system. The rig's feed pump pumps the fuel into a feed tank where it is injected with a feed of nitrogen and de-ionized water. This enabled the fuel to stabilize at a level where it is saturated with dissolved water. A sample of the fuel at this stage is tested using a Karl Fischer coulometric titrator, which reads the total parts per million (ppm) of water in the fuel. This reading is known as the saturated tank level.

The next step injects a constant amount of free water into the fuel stream. This injection rate was set using an explosion-proof electric needle injection pump and a syringe of de-ionized water. The target level of free water injection is 200-300 ppm. This condition was chosen because it represents a significant increase which could be seen in real field conditions. The saturated fuel stream is pumped through the rig using the test pump. This action atomizes the injected water stream with the water saturated fuel stream through the use of recirculation valves. Three samples of this fuel are tested in the Karl Fischer to give an average reading of the total water upstream of the test element housing. These samples are noted as the upstream readings.

The last step is to flow the water and fuel through the filter/coalescer cell test housing. The filter/coalescer and test separator will act on the fuel to separate the water from the fuel using both size occlusion and polarity of materials. Once the fuel has passed through the housing, three samples are tested in the Karl Fischer to give an average reading of the total water at this point in the test rig. These samples are known as the downstream samples.

The test was run for 80 hours of fuel flow through the test element housing at a rate of 33 milliliters per minute. During this time the 7 Karl Fischer measurements above will be measured once an hour. In addition, the total and differential pressure across the test element was measured. If the differential pressure is greater than 15 psi, the filter has been compromised and the test will be reported as a failure. In order to pass the test, the difference in water levels

between the saturated tank and the downstream readings must be within 100 ppm of each other. If for four or more hours the difference in average readings is greater than 100 ppm, the test will be reported as a failure. The 100 ppm condition has been chosen because it allows for variations in the fuel sample, as well as random events such as excess water concentration upstream or incomplete saturation due to variations in nitrogen pressure and flow. The NCT theory of operation is shown in Figure 1.

4.0 DISCUSSION

The F76 diesel fuel was tested to determine its viability as a baseline for future NCTs. No additives were present in the fuel. The saturated, upstream and downstream total water concentrations in the fuel stream are graphically represented below in Figure 2. These are graphed by test hour to show the trends in the water levels over the test duration.

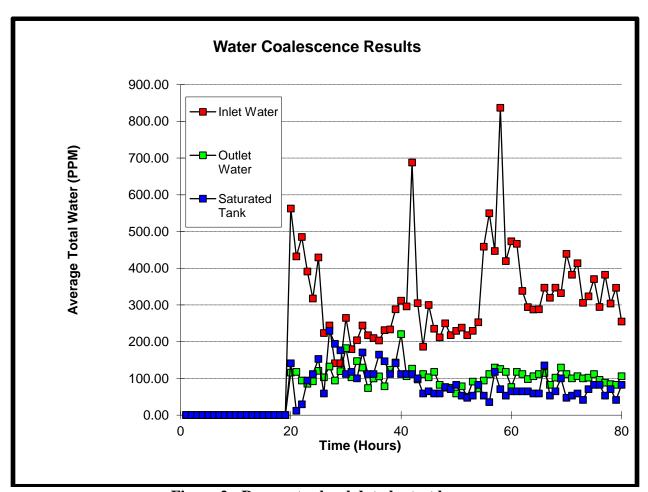


Figure 2: Raw water level data by test hour

As shown in Figure 2, the injected water level varied in concentration, but remained well in excess of the saturated level. Due to equipment issues with the Karl Fischer titrators, the first 19 data points are not reported; however since the trends after that time are fairly linear, the data is

considered valid. The average injected water concentration was 237 ppm and the average tank water saturation level was 88 ppm.

The greatest water separation is seen when comparing the downstream fuel with the saturated fuel in order to see how well the test element removes the injected free water. The difference between the saturated fuel and the downstream fuel is seen in Figure 3 below.

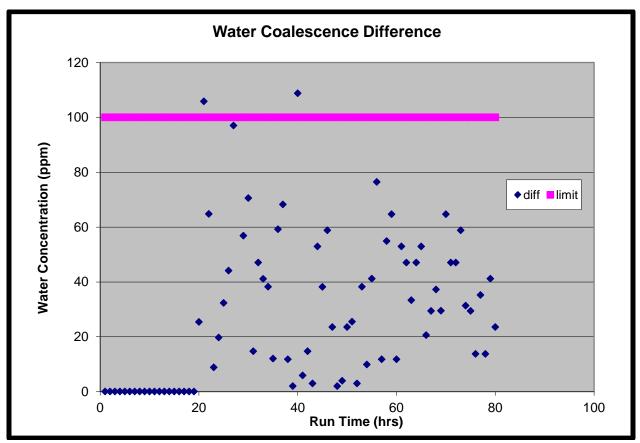


Figure 3. Calculated Water Coalescence Data

Figure 3 shows that all but two points were well under the 100 ppm limit. The average difference between the saturated and downstream water levels was 38 ppm indicating satisfactory coalescence. The differential pressure was between 4-8 psi throughout the test, indicating that this fuel did not have an adverse affect on system pressure.

5.0 CONCLUSIONS

The petroleum based F76 test fuel all the NCT requirements satisfactorily.

6.0 RECOMMENDATIONS

The petroleum based F76 test fuel is recommended for further testing.

7.0 REFERENCES

SWP44FL-003 Navy Fuels and Lubricants CFT Navy Coalescence Tester (NCT)

NF&LCFT REPORT 441/12-013 20 June 2012 Page 6

This Page Intentionally Left Blank

APPENDIX A Table A-1 Test Data

	10	ible A-1 1	est Butu		Differential
Run Time	avg. inlet	avg. outlet	avg. tank	Diff	Pressure
hour	ppm	ppm	ppm	ppm	PSI
1	ppm	ppm	ppiii	bhiir	101
2					
3					
4					
5					
6					
7					
8					
9					
10					
11					
12					
13					
14					
15					
16					
17					
18					
19					
20	562.51	115.62	141.00	25.38	
21	432.10	117.58	11.76	105.82	
22	485.01	94.07	29.30	64.765	
23	390.95	85.25	94.06	8.815	
24	317.45	92.00	111.70	19.69667	
25	429.26	120.50	152.80	32.30333	
26	223.40	102.88	58.79	44.09	
27	243.98	132.28	229.28	97.005	4
28	141.09	94.06	194.00	99.94	4
29	141.09	119.54	176.37	56.83333	4
30	264.55	182.25	111.70	70.545	4
31	179.31	102.88	117.58	14.7	4
32	203.80	146.98	99.94	47.04	5
33	243.97	129.37	170.46	41.09	5
34	217.40	73.49	111.70	38.21	5
35	209.68	99.69	111.70	12.01	5
36	203.13	105.42	164.60	59.18	5
37	231.26	78.38	146.61	68.22667	5
38	233.20	123.46	111.70	11.76	5
39	288.06	143.08	141.09	1.986667	5
40	311.58	220.46	111.70	108.76	4
41	295.90	105.82	111.70	5.88	4

APPENDIX A
Table A-1 Test Data (Continued)

Run Time	avg. inlet	avg. outlet	avg. tank	dP	Run Time
(test hour)	(ppm)	(ppm)	(ppm)	(psi)	(test hour)
42	687.83	126.40	111.70	14.7	8
43	304.71	97.00	99.94	2.94	6
44	186.15	111.70	58.79	52.90667	6
45	299.82	102.83	64.67	38.16	6
46	235.16	117.58	58.79	58.78667	8
47	211.64	82.30	58.79	23.51333	8
48	249.85	74.46	76.43	1.973333	8
49	217.52	74.47	70.55	3.916667	8
50	229.28	58.79	82.30	23.51	8
51	238.10	78.39	52.91	25.47667	8
52	217.52	49.97	47.03	2.94	8
53	229.44	91.12	52.91	38.21	8
54	252.79	72.51	82.36	9.853333	8
55	458.55	94.06	52.90	41.16	6
56	549.68	111.70	35.27	76.43	6
57	446.80	129.34	117.58	11.75667	6
58	836.90	125.42	70.55	54.86667	6
59	419.36	117.58	52.91	64.67	6
60	473.25	76.43	64.67	11.75667	6
61	466.39	117.60	64.67	52.92667	6
62	338.04	111.69	64.67	47.02	7
63	293.94	97.98	64.67	33.31	7
64	287.48	105.82	58.79	47.03	7
65	288.07	111.70	58.79	52.90667	7
66	346.86	114.64	135.21	20.57	7
67	319.42	82.30	52.91	29.39	7
68	346.86	101.90	64.69	37.21	7
69	332.11	129.40	99.94	29.46	7
70	438.96	111.69	47.03	64.66333	7
71	382.13	99.94	52.91	47.03	7
72	413.48	105.82	58.79	47.03	7
73	305.69	99.94	41.15	58.79	7
74	323.34	101.87	70.55	31.32	7
75	370.37	111.70	82.30	29.39667	7
76	294.32	96.02	82.30	13.72333	7
77	382.13	88.18	52.98	35.2	7
78	303.74	84.26	70.55	13.71333	7
79	346.58	82.30	41.15	41.15333	7
80	254.78	105.82	82.30	23.52	8

Note: Issues with the Karl Fischer titrators precluded the capture of data at test hours 47, 58 though 64, and 67.

REPORT DOCUMENTATION PAGE

Form Approved OMB No. 0704-0188

Public reporting burden for this collection of information is estimated to average 1 hour per response, including the time for reviewing instructions, searching existing data sources, gathering and maintaining the data needed, and completing and reviewing this collection of information. Send comments regarding this burden estimate or any other aspect of this collection of information, including suggestions for reducing this burden to Department of Defense, Washington Headquarters Services, Directorate for Information Operations and Reports (0704-0188), 1215 Jefferson Davis Highway, Suite 1204, Arlington, VA 22202-4302. Respondents should be aware that notwithstanding any other provision of law, no person shall be subject to any penalty for failing to comply with a collection of information if it does not display a currently valid OMB control number. PLEASE DO NOT RETURN YOUR FORM TO THE ABOVE ADDRESS.

1. REPORT DATE (DD-MM-YYYY)	2. REPORT TYPE	3. DATES COVERED (From - To)
06-20-2012	Technical	01-03-2012 to 01-16-2012
4. TITLE AND SUBTITLE		5a. CONTRACT NUMBER
Navy Coalescence Test or	n Petroleum F-76 Fuel	N/A
		5b. GRANT NUMBER
		N/A
		5c. PROGRAM ELEMENT NUMBER
		N/A
6. AUTHOR(S)		5d. PROJECT NUMBER
Laing, Christopher; Auth	nor	N/A
Buffin, Jack; Editor		5e. TASK NUMBER
Kamin, Richard; Editor		N/A
Mearns, Douglas; Editor		5f. WORK UNIT NUMBER
, 8		N/A
7. PERFORMING ORGANIZATION NA	ME(S) AND ADDRESS(ES)	8. PERFORMING ORGANIZATION REPORT
		NUMBER
Naval Fuels & Lubricants	3	NF&LCFT Report 441/12-013
Cross Functional Team		
22229 Elmer Road		
Patuxent River, MD 2067	70	
9. SPONSORING / MONITORING AGE		10. SPONSOR/MONITOR'S ACRONYM(S)
Chief of Naval Operations N42		N/A
2511 Jefferson Davis Hig	jhway	
Arlington VA 22202		11. SPONSOR/MONITOR'S REPORT
		NUMBER(S)
		N/A
12 DISTRIBUTION / AVAIL ARILITY ST		

12. DISTRIBUTION / AVAILABILITY STATEMENT

A Approved for public release; distribution is unlimited.

13. SUPPLEMENTARY NOTES

N/A

14. ABSTRACT

The Navy Coalescence Test (NCT) is a fit-for-purpose test which uses a specially manufactured small filter/coalescer cell to simulate the performance of a full scale filter/coalesce system while utilizing a small volume of fuel. This testing is designed to predict the performance of the filter/coalescer systems currently in use in the fleet.

Recently there have been numerous requests to test additives for diesel fuel and this test was conducted to create a petroleum non-additized diesel baseline. This test fuel met all the test requirements and passed the NCT. It is recommended for use in further NCT testing.

15. SUBJECT TERMS

Navy Coalescence Test, NCT, F-76

16. SECURITY CLAS	SIFICATION OF:		17. LIMITATION OF ABSTRACT	18. NUMBER OF PAGES	19a. NAME OF RESPONSIBLE PERSON Douglas F. Mearns
a. REPORT	b. ABSTRACT	c. THIS PAGE	Unclassified	15	19b. TELEPHONE NUMBER (include area code)
UNCLASSIFIED	UNCLASSIFIED	UNCLASSIFIED	Unlimited		301-757-3421